

# User Manual



## Models:

UVD600, UVD800, UVD1000,  
UVD1200, UVD1500

UVD600/S, UVD800/S, UVD1000/S  
UVD1200/S, UVD1500/S




system listed by  
IAPMO R&T to:



manufactured by:  
UV Dynamics - a Castle Circuits Inc. Business Group  
315 Neptune Crescent, London, ON, Canada  
800.667.4629 519.452.7520  
support@uvdynamics.com  
www.uvdynamics.com



NSF/ANSI 61  
NSF/ANSI 372  
CSA B483.1



## INTRODUCTION

Thank you for trusting UVDynamics with your drinking water disinfection! Please read and follow all instructions. Proper installation and maintenance is required to ensure reduction of microbiological contaminants.

Your UVDynamics system consists of a stainless steel disinfection chamber, quartz glass sleeve, UV lamp, and electronic power supply (ballast). Water flows through the disinfection chamber and is exposed to UV light from the lamp, which sits inside the quartz glass sleeve. The electronic power supply powers the UV lamp, alarms if it fails, and reminds you to change your lamp every year. The optional UV sensor monitors the UV level in real time, and alarms if there is a drop in performance.

Even though it is able to light for several years, **the UV lamp must be changed after 1 year of service.** The amount of UV-C light emitted by a UV lamp decreases greatly after 1 year of use. Your UVDynamics system has a lamp change reminder timer that will notify you when you are nearing the end of lamp life.

Genuine UVDynamics lamps are made by knowledgeable and trusted lamp manufacturers in North America. Installing a low-cost knock-off lamp can compromise the effectiveness of your UV disinfection system and potentially damage your electronic power supply. Without a UV monitor there is no way to know if a third party lamp is outputting the amount of UV-C light needed to disinfect water.

Genuine UVDynamics lamps can be identified by their blue ceramic end caps, and UVDynamics logo.



## SAFETY INFORMATION



UV lamps contain mercury (Hg). Dispose or recycle in accordance with local regulations. If the lamp breaks, avoid inhalation or ingestion; avoid exposure to eyes and skin. Do NOT use a vacuum cleaner or broom to clean mercury waste. Do NOT throw mercury into your household garbage.

### **CAUTION**

***NEVER OPERATE UV LAMP OUTSIDE OF THE UV DISINFECTION CHAMBER  
EXPOSURE TO UV LIGHT CAN RESULT IN EXTREME BURNING OF SKIN AND EYES***

- Do not use this unit for anything other than its intended potable water application.
- The use of attachments not recommended, approved, or sold by the manufacturer/distributor may result in an unsafe condition.
- Before any cleaning or maintenance, always unplug the unit.
- Protect your unit from freezing. Drain all water from the unit if freezing temperatures are possible.

### **DANGER**

- Do not plug the unit in if any of the external surfaces or electrical parts are wet. Moderate condensation on the disinfection chamber is normal.
- To avoid possible electric shock, special care should be taken since water may be present near electrical equipment.
- Unless referred to in these instructions, do not attempt repairs yourself. Contact the manufacturer for service advice.
- Do not operate this system if it has a damaged electrical cord or plug, is malfunctioning, or has been dropped or damaged in any way.

## WATER QUALITY REQUIREMENTS

|                        |                                                                                                                                                                                                                                                                                                                                                                                                                                    |
|------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| Turbidity              | < 1NTU                                                                                                                                                                                                                                                                                                                                                                                                                             |
| Suspended Solids       | < 10mg/L                                                                                                                                                                                                                                                                                                                                                                                                                           |
| Colour                 | none                                                                                                                                                                                                                                                                                                                                                                                                                               |
| Tannins/Other Organics | < 0.1 ppm                                                                                                                                                                                                                                                                                                                                                                                                                          |
| Total Iron             | < 0.3 mg/L                                                                                                                                                                                                                                                                                                                                                                                                                         |
| Manganese              | < 0.05mg/L                                                                                                                                                                                                                                                                                                                                                                                                                         |
| Hardness               | < 7 gpg                                                                                                                                                                                                                                                                                                                                                                                                                            |
| UV Transmittance       | The flow rates and doses specified for these units assume a UVT of 95%.<br>Installing a system on water with a lower UVT% will result in a lower effective UV dose.<br>Systems with UV Detect are calibrated to a 40mJ/cm <sup>2</sup> dose at the stated flow rate, resulting in a 20mJ/cm <sup>2</sup> dose at the 50% alarm threshold.<br>Installing a monitored system on water with lower than 80% UVT will result in alarms. |

Your UV disinfection system requires clean water for optimum performance. You should only operate your unit if the source water meets these standards.

If your water exceeds these limits you may require more pretreatment to correct these issues before installation of your UV disinfection system.

**All input water, regardless of water quality, should have a 5 micron pre-filter installed prior to the UV system. Installing a monitored system on water that does not meet these requirements may result in frequent alarms.**

## INSTALLATION CAUTIONS

**1** Connect your UV unit to a grounded (3 pronged) GFI receptacle (120V, 60HZ), and ensure that the lamp connector ground wire is connected to the ground stud on the top of the UV chamber.

Note: Power source for applications outside of North America must match requirements of the unit (eg. 240V, 50Hz).

**2** It is strongly recommended to install your UV power source on a dedicated electrical line to prevent damage from large equipment such as pumps, freezers, refrigerators, compressors, etc. A CSA certified (or equivalent) surge protector is required to protect the electronic ballast from power surges. Damage due to power surges is not covered by warranty.

**3** Install your UV system and prefilter in a location that will limit leakage damage to other equipment or infrastructure. Re-examine installation for leaks several hours after installation, service, or maintenance activities have been performed. Small leaks can cause significant damage if not corrected promptly - damage caused by leakage is not covered by the product warranty.

**4** UVDynamics disinfection devices are designed to be installed on the cold water line only.

**5** Your unit should ideally be installed vertically with the lamp connector pointing upwards – the water source should be connected to the inlet port on the bottom of the unit. If space limitations require a horizontal installation, the inlet and outlet ports must point upward and the ballast must be mounted above the chamber.

**CAUTION:** Reversing the flow direction by connecting the water source to the top port in a vertical installation could result in reduced disinfection performance and improper operation of the flow regulator (if present).

**6** Installing bypass plumbing with shut off valves around your UV disinfection unit will make it possible to access emergency (non-potable) water in your building if a system is removed for service, or during power outages on systems with solenoid valves.

**7** Install your UV Dynamics disinfection system indoors in a protected area where the temperature does not fall below 4°C(40°F) and the humidity level is low (to prevent excessive condensation on the chamber). This unit functions ideally in a temperature range from 9°C - 29°C. (49°F – 85°F)


**8** Use teflon tape on all pipe connections. DO NOT USE ANY OTHER SEALANT.

**9** UV light can break down plastic over time. To prevent leaks from developing, PEX and other plastic plumbing should not be connected directly to the inlet and outlet ports. A metallic light dam of either 16"(40cm) straight piping, or an elbow should be installed on the inlet and outlet ports to prevent damage to plastic plumbing.

**10** Provide space above the gland nut equal to the length of the quartz sleeve to allow for UV lamp and quartz sleeve servicing.


**11** If you intend to drain the system for winterization you should install a drain port valve at the inlet of the system.

# GETTING TO KNOW YOUR UV SYSTEM

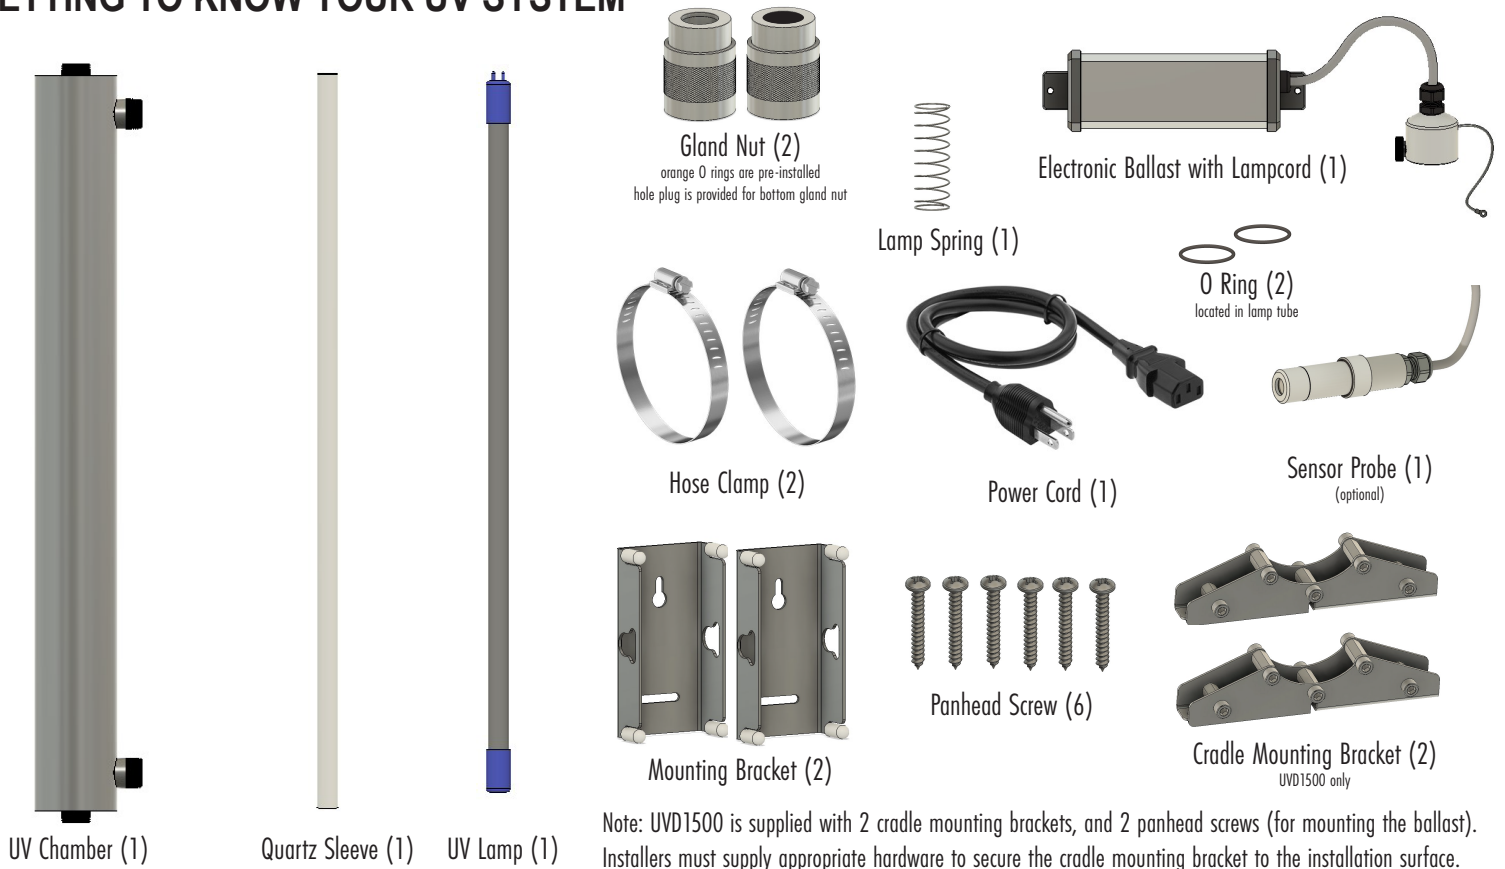

## SUGGESTED INSTALLATION

- ① Sediment Pre-Filter (5 micron minimum)
- ② Drain Port (recommended for winterization)
- ③ Bypass valve (allows water during off-line servicing)  
NOTE: Valve must remain closed during normal operation.  
A leaking bypass valve will result in untreated water entering plumbing distribution.
- ④ Electronic Ballast
- ⑤ Minimum clearance above system equal to quartz sleeve length
- ⑥ UV Chamber
- ⑦ UV Sensor Probe (optional)
- ⑧ Isolation Valve

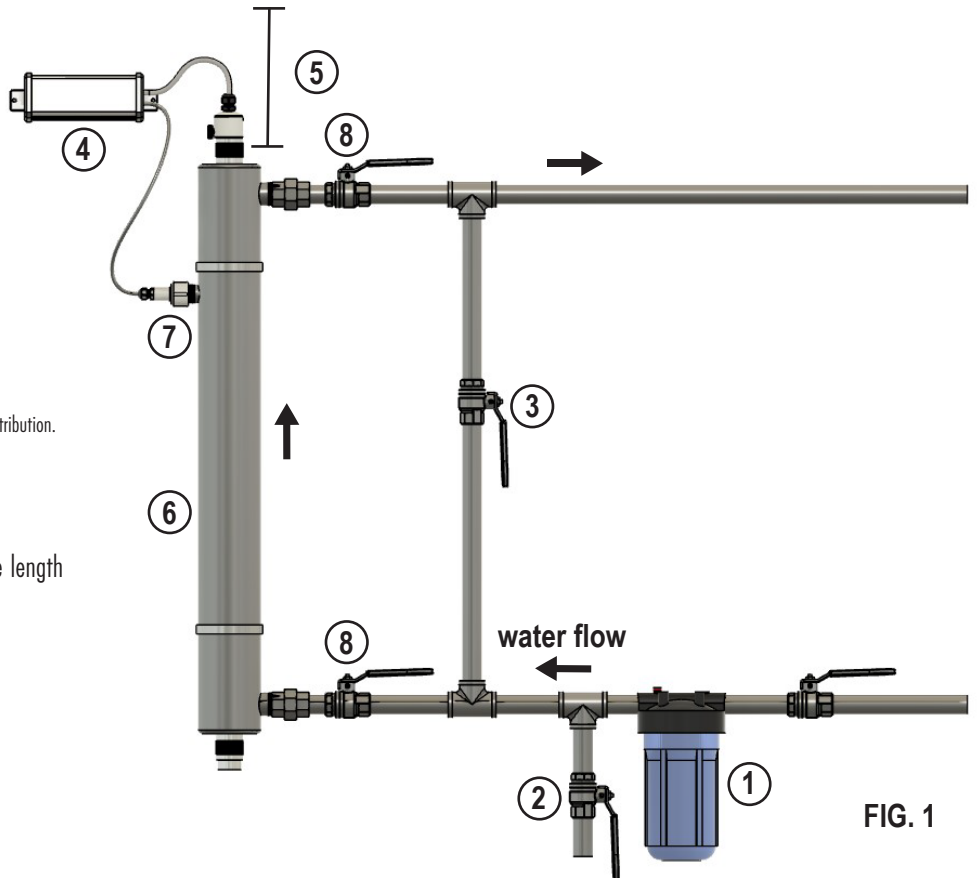

The UV disinfection system should be the last step of your water treatment system. If your water treatment chain involves a pump and pressure tank the UV should be after the pressure tank, not between the pump and tank. Your UV system should be installed after all other water treatment equipment, before the plumbing splits into hot and cold lines.



# INSTALLATION PROCEDURE

**1** Shut off the main water supply valve.

**2 UVD600, UVD800, UVD1000, UVD1200:** Mount the unit to the wall using the brackets provided. Use keyhole to attach one screw in desired location, then level and attach second screw, tightening both until secure. Repeat for second bracket, spacing them to sit inside of the inlet and outlet ports on the chamber. Open gear clamps and slide through slots in brackets. Place chamber on brackets and tighten gear clamps. Overtightening can damage silicone feet and scratch chamber. Clamps can be rotated before fully tightening to hide the gear mechanism inside the bracket. See FIG. 2.

**UVD1500:** Mount the unit using the cradle brackets provided. Select a screw (not supplied) appropriate to the mounting surface. System must be mounted to studs, masonry, or other surface capable of supporting the load of the UV chamber when filled with water. See FIG 3.

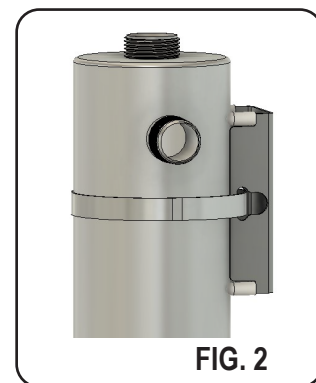


FIG. 2

**Note:** If installing the system horizontally, inlet and outlet ports must point upwards.

**3** Install new plumbing using FIG. 1 as a guide. **Note:** When installing the 5 micron pre-filter, make sure the flow arrows point in the same direction as the water flow.

**WARNING:** If soldering, do not allow heat near plastic threads or fittings.

**4** Mount the electronic ballast **above the chamber** on the wall using two (2) panhead screws.

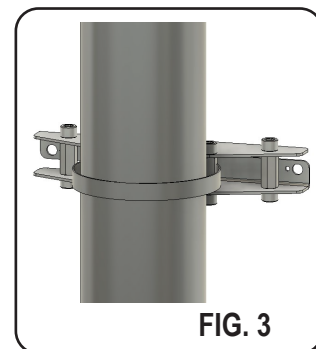


FIG. 3

**Note:** Use clean, dry gloves or cloth when handling the quartz sleeve and UV lamp.  
**Do not touch quartz glass with bare hands.**

**5** Place a black O ring over one open end of quartz sleeve, approximately 1cm onto the sleeve. Gently insert other end of sleeve into the chamber, being sure to support the sleeve as you slide it through the opposite end of the chamber. Centre the quartz sleeve in the chamber, then place the second black O ring over the remaining end of the quartz sleeve and slide both O rings towards the threaded fitting, seating them snugly against the chamber.

**6** Hand tighten gland nut with the hole plug over the quartz sleeve at the inlet (bottom) end of the chamber. Hand tighten gland nut with no hole plug at the outlet (top) end of the chamber. Do not use tools to tighten; overtightening can cause leaks. Do not use any teflon tape, grease, pipe dope, or other sealants or lubricants on glandnut threads.

**7** Drop the lamp spring into the quartz sleeve. Holding the lamp by the top ceramic cap, gently insert into the quartz sleeve (the spring should catch the lamp and keep the pins above the gland nut to make connecting the lamp cord easier).

**8** Connect the white lamp connector at the end of the ballast lamp cord to the UV lamp. The pins are in a rectangle configuration and can be plugged in two ways - either way will work. The UV lamp pins fit snugly; the lamp should be secure when being held only by the lamp cord.


**9** Push the lamp cord cap down snugly onto the gland nut and hand tighten the retainer screw.

**10** Remove the nut from the ground stud at the top of the unit. Next, place the ground wire (green wire with yellow stripe) over the stud and re-install nut and tighten.

**11 Monitored Systems:** Insert sensor probe into the port on the side of the chamber; hand tighten the white cap firmly. Overtightening can damage plastic threads. Connect the sensor probe cable to the ballast, using either data port.

## INSTALLATION PROCEDURE CONT'D

**Note:** Your UVDynamics UV detection probe has a removeable secondary quartz window on the face of the probe that can be cleaned or replaced in the instance of fouling. See FIG 4. A spare window is included with your unit - be sure to store it somewhere safe for later use. The sensor cap serves only to hold the secondary quartz window in place and it should be screwed down only enough to secure the window. Overtightening the cap will crack the secondary quartz window, which can obscure UV readings and cause the primary probe body to become fouled.

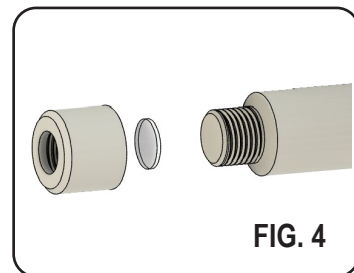

**12** Open isolation valves on either side of the disinfection chamber. Check for leaks. Open supply valve slowly; bleed air from system.

**13** Connect electronic ballast to AC line via the surge protector. The ballast audio alarm will sound three times before the lamp lights.

Your UVDynamics disinfection system is now ready for service. Before service begins, all household plumbing lines should be chemically disinfected.

## DISINFECTION PROCEDURE

UV disinfection is a physical process that does not add any chemicals to your water, and does not provide any residual disinfection. Therefore, it is necessary to ensure your entire plumbing distribution system is chemically disinfected to prevent re-contamination of your water after the UV system. This procedure should be performed immediately after installing your UV system, and following any power outage or service that requires the system to be shut down. It is recommended to disinfect your plumbing at least once per year, during the annual maintenance.

**THE FOLLOWING DISINFECTION PROCEDURE IS GENERALLY ACCEPTED AS BEING SUITABLE FOR THE DISINFECTION OF PLUMBING SYSTEMS KNOWN TO BE CONTAMINATED. IF YOU ARE UNCERTAIN ABOUT THE EFFICACY OF THIS PROCEDURE YOU ARE ADVISED TO CONTACT THE LOCAL HEALTH AUTHORITY RESPONSIBLE FOR WATER SAFETY.**

**1** Shut off the water supply and de-pressurize the water treatment chain either by pressing the pressure release button on a filter housing, or opening a tap in the building.

**2** Loosen filter housing(s) using the appropriate wrench and remove filter cartridge(s).

**3** Add 2 cups of unscented household chlorine bleach (5.25% concentration) to the empty filter housing and re-install.

**Note:** Bleach can damage some types of filter cartridges. Do not re-install filter cartridges until disinfection procedure is complete. The UV system should be powered on during the disinfection procedure.

**4** Open water supply, then operate a water fixture in the building until you can smell the chlorine bleach, then close it. Repeat this process for all cold and hot water faucets, fixtures, and appliances, adding bleach if necessary. *This includes showerheads, outside taps, dishwashers, laundry equipment and any other appliance connected to the plumbing system.*

**5** Leave the bleach solution for at least 30 minutes.

**6** Shut off the water supply and de-pressurize the water treatment chain once again. Loosen the filter housing(s), empty out any remaining bleach, and reinstall filter cartridge(s). Open the supply valve and flush all fixtures and appliances thoroughly to complete the disinfection procedure.

**Note:** Adding chlorine bleach solution to a hot water heater that has been used with untreated water, or water with excessive iron, manganese, or other organic contaminants may lead to oxidization of these materials. If you feel that these conditions may apply to your installation, a thorough flushing of the hot water tank should be undertaken to eliminate the oxidized material from the system.

## UV BALLAST FEATURES (Standard)

UVD600, UVD800, UVD1000, UVD1200, UVD1500

The microprocessor controlled UV ballast supplied with your UVDynamics system has both audio and visual alarms to indicate lamp operation and an annual lamp change reminder timer.

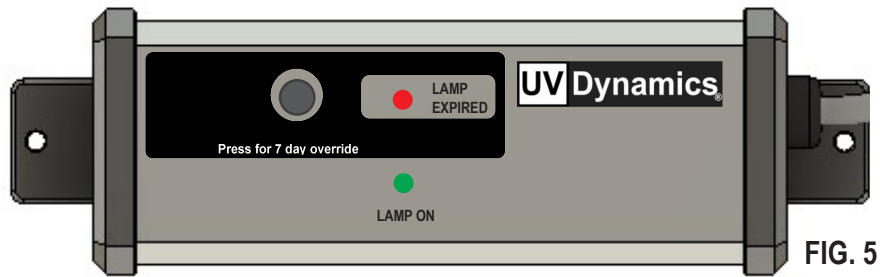


FIG. 5

**UV Ballast Start-Up Sequence:** When AC power is applied to the UV ballast, the lamp is lit - as indicated by the green 'LAMP ON' LED. The ballast performs a self-test of the 'LAMP EXPIRED' LED and alarm buzzer consisting of three buzzer beeps and three red LED flashes. If a solenoid is connected to the UV ballast, it will activate on completion of the self-test sequence.

**Normal Operation:** During normal operation only the green 'LAMP ON' LED is illuminated.

**Lamp Timer Operation:** After eleven (11) months of operation, the 'LAMP EXPIRED' LED will flash and the buzzer will sound, indicating that the timer function is in the 28-day grace period. Pushing the button during the grace period will silence the buzzer for a seven-day period, but the LED will continue to flash. The buzzer can be silenced up to four times during the 28 day grace period. At the end of the 28-day grace period the ballast indicates the lamp is expired with a solid red LED and buzzer. The UV lamp is not shut down in this alarm mode and the solenoid valve drive is not disabled.

**Time Remaining:** When the lamp change reminder timer is not in the grace period or lamp change alarm mode, the number of months of lamp life remaining can be determined by pressing the timer button and counting the number of red LED flashes. Ex. 5 flashes = 5 months of remaining lamp life.

**Solenoid Valve Output:** The UV power source is capable of directly powering a solenoid valve, which will shut off water flow during lamp failure alarm conditions. Systems should have a minimum 12" length of metal piping between the UV system and solenoid valve to prevent heat from the UV system damaging the solenoid valve.

**Lamp failure:** When the UV power source detects a lamp failure or enters the auto shutdown mode due to abnormal operating conditions, the alarm buzzer sounds and the green 'LAMP ON' LED is extinguished. If connected, the solenoid valve will close, shutting off the water flow.

**Note:** The UV ballast is designed to shut down if the AC input voltage is outside of operating limits. When a lamp failure alarm is active you should unplug the unit from the AC power source, wait for fifteen seconds and then reconnect to the AC power source. If the failure was due to out of limit AC power, the unit will re-ignite the lamp and operate normally. If this does not resolve your lamp failure condition, refer to the trouble-shooting guide.

## UV BALLAST FEATURES (Monitored)

UVD600/S, UVD800/S, UVD1000/S, UVD1200/S, UVD1500/S

The microprocessor controlled UV ballast supplied with your UVDynamics system has both audio and visual alarms to indicate lamp operation and an annual lamp change reminder timer.

**UV Ballast Start-Up Sequence:** When AC power is applied to the UV power source the lamp is lit - as indicated by the green 'LAMP ON' LED. The ballast performs a self-test of the 'LAMP EXPIRED' LED and alarm buzzer consisting of three buzzer beeps and three red LED flashes. If a solenoid is connected to the UV power source it will activate when the UV level exceeds 50%. This may take several minutes depending on water temperature, UV transmission of the water, and age of the lamp.

**Normal Operation:** During normal operation the green 'LAMP ON' LED is illuminated and the two digit display indicates the UV level in %.

## UV BALLAST FEATURES (monitored) CONT'D

**Lamp failure:** When the UV power source detects a lamp failure or enters the auto shut down mode due to abnormal operating conditions, the alarm buzzer sounds and the green 'LAMP ON' LED and two digit display are extinguished. If connected, the solenoid valve will shut off the water flow.

**Note:** The UV ballast is designed to shut down if the AC input voltage is outside of operating limits. When a lamp failure alarm is active you should unplug the unit from the AC power source, wait for fifteen seconds, and then reconnect to the AC power source. If the failure was due to out of limit AC power, the unit will re-ignite the lamp and operate normally. If this does not resolve your lamp failure condition, refer to the trouble-shooting guide.

**Lamp Timer Operation:** After eleven (11) months of operation, the **E5** lamp change reminder code will be displayed and the buzzer will sound, indicating that the timer function is in the 28-day grace period. Pushing the button during the grace period will silence the buzzer for a seven-day period, but the **E5** code will remain. The buzzer can be silenced up to four times during the 28 day grace period; under no circumstance does the grace period exceed 28 days. At the end of the 28-day grace period the **E5** code is replaced by **E6** (lamp life expired). When the **E6** error code is active the lamp must be replaced and the lamp timer reset. **Note:** *The UV lamp is not shut down in this alarm mode and the solenoid valve drive is not disabled.*

**Time Remaining:** When the lamp change reminder timer is not in the grace period or lamp life expired mode, the number of weeks of lamp life remaining can be shown on the two digit display by pressing the timer reset button.

**Low UV Intensity:** If the output of the UV detection system falls below 50%, a low UV alarm will be initiated and error code **E1** will be displayed. If a solenoid valve is installed, it will close to stop the flow of water.

**Alarm Override:** The UV power source has an alarm override feature to enable emergency water flow when the system has entered a low UV alarm state. Pressing the button during error code **E1** will initiate the override, which is active for 24 hours, but can be reset indefinitely. The alarm override feature will not function if the lamp has failed. The display will read **E4** while the alarm override is active. Pressing the button during the alarm override will terminate the override mode and clear the **E4** code.

**⚠ CAUTION:** The water treated by the unit will not be properly disinfected when the alarm override is in operation. The plumbing distribution system should be disinfected after the **E1** alarm has been resolved.

**Solenoid Valve Output:** The UV power source is capable of operating a solenoid valve kit, which will shut off water flow during lamp failures, low UV alarm conditions, and power outages. On vertically mounted systems, a solenoid valve can be directly mounted to the inlet port. Horizontally mounted systems should have a minimum 12" length of metal piping between the UV system and solenoid valve to prevent heat from the UV system damaging the solenoid valve. A remote solenoid interface (RSI) is required for monitored systems to provide independent power for the solenoid valve, as well as a secondary override option.

**UV Sensor Error:** If the UV sensor probe is not connected to the electronic ballast, or if communication with the sensor is not possible, the error code **E3** will be displayed. Verify that the sensor plug is fully inserted into the electronic ballast before replacing the UV sensor probe.

### Display & Error Code Summary

**E1 - Low UV Level**  
**E3 - Sensor Communication Error**  
**E4 - Alarm Override Active**  
**E5 - Change Lamp**  
**E6 - Lamp Life Expired**  
**E7 - Sensor Self Test Fail**

**Note:** The sensor self test cannot complete when the UV level has dropped below the alarm threshold. If your system has both **E1** and **E7** showing, resolving the **E1** will often clear the **E7** as well.

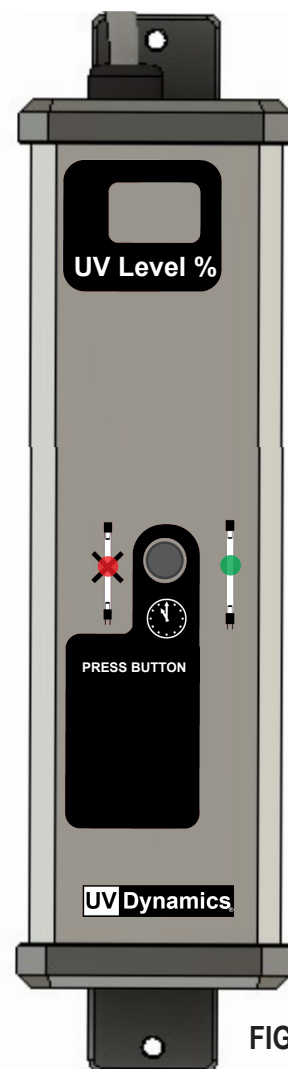


FIG. 6

# UV BALLAST FEATURES (monitored) CONT'D

## Diagnostic Display

A long push on the timer reset button on the UV power source initiates the diagnostic display and sensor self test function of the system. In sequence, the display will output the parameter, followed by the parameter value.

- (lr) Lamp life remaining (in weeks)
- (ul) UV level (in %)
- (tf) Disinfection chamber temperature F°
- (tc) Disinfection chamber temperature C°
- (fn) Cold Spot Fan™ status 1=on 0=off
- (at) Alarm threshold - "n" for General Use System
- E7 if the sensor self test detected a sensor failure

**Note:** The diagnostic display does not function if a lamp failure condition exists. The Cold Spot Fan™ is an optional accessory and may not be present on your system.

## OPERATING and MAINTENANCE

Your UV system is on continuously during normal use. The system is not damaged by long periods of no water flow, but heat may build up during this time. **WARNING:** The first water used after a period of no water flow can be very hot. It is recommended to flush a toilet or run a tap to clear this hot water.

**Note:** Do not cycle your system on and off during short periods of non-use as this will shorten the life-span of your UV lamp.

**CAUTION:** Protect your unit from freezing. Drain all water from the unit if freezing temperatures are possible.

**Ultraviolet lamp replacement:** The ultraviolet lamp located inside the chamber will operate effectively, around the clock, for approximately one year. The lamp will light longer than that. However, the UV light penetration may fall below the prescribed safety level. Therefore, **annual lamp replacement is necessary regardless of whether the lamp is still lit.**

**Quartz sleeve replacement:** At minimum, the quartz sleeve should be cleaned annually, and replaced every 3 years due to the potential for microscopic fouling not visible to the eye. Quartz sleeves may need to be cleaned and replaced more frequently depending on the severity of fouling.

**Quartz sensor window (monitored only):** The window should be cleaned and replaced at the same intervals as the quartz sleeve.

**O ring replacement:** The black sleeve O rings should be replaced annually to prevent leaks; replacement black O rings are included with genuine UVDynamics UV lamps. Water damage due to dried out O rings is not covered under warranty. The orange O ring in the gland nut should be replaced every 3 years; replacement orange O rings are included with genuine UVDynamics quartz sleeves.

## Replacing the UV Lamp and Cleaning the Quartz Sleeve

**Note:** Do not touch the lamp glass or the quartz sleeve with your fingers. Handle lamp by ends only; use soft, dry gloves or cloth.

- 1** Turn off all water supplies to the unit and unplug the system from the electrical outlet. Depressurize the UV system by opening a faucet and then close the valve at the UV system outlet. **CAUTION:** The ceramic UV lamp end cap can be hot. Wait for it to cool.
- 2** Unscrew the ground nut and remove the ground wire (green with yellow stripes). Loosen black screw on the side of lamp cord.
- 3** Carefully extract the lamp connector from the sleeve gland nut assembly to expose just the top of the lamp. While holding the top of the lamp firmly, remove the lamp connector. Be careful not to drop the lamp into the quartz sleeve as they are easily broken.
- 4** Carefully slide the UV lamp out of the quartz sleeve and discard according to local regulations. Do not lose lamp spring.
- 5** Remove the quartz sleeve by loosening the gland nuts and carefully extracting it from the unit. **CAUTION:** The quartz sleeve is fragile and is easily chipped or broken – use care when removing or installing. Remove and discard black O rings.
- 6** Clean the quartz sleeve and sensor window (if present) with a vinegar solution or readily available scale removal product (Limeaway, CLR etc.) and a soft cloth. Do not use abrasive materials. If the quartz components cannot be fully cleaned they should be replaced.



Replacing the UV Lamp and Cleaning the Quartz Sleeve Cont'd

**7** Follow steps 5 through 12 in the Installation Procedure section to reassemble your UV system, using new black O rings and a new UV lamp.

RESETTING THE LAMP CHANGE TIMER

The lamp change timer is reset by disconnecting the UV ballast from the AC supply, waiting for fifteen seconds, pressing and holding the reset button, and then reconnecting the AC supply *while the button is held down*. Do not release the button until the UV ballast emits a long, solid beep, indicating the reset was successful.

**It is important to reset the lamp timer every time a new UV lamp is installed**, even if the system was not in the lamp change timer mode at the time of the lamp change. The timer reset will not work unless the system is in a lamp change or lamp failure alarm mode. If you need to reset the lamp timer and the system is not in either alarm mode, you should disconnect the AC supply, disconnect the lamp, then reconnect the AC supply. The UV ballast will try three times to light the lamp (3 quick beeps), and then settle into a lamp failure alarm (steady beeping). Install the new lamp and follow the standard lamp timer reset procedure.

TROUBLESHOOTING

| PROBLEM                                               | POSSIBLE ISSUE                                                                                                                        | SUGGESTED ACTION                                                                                                                                                                                                           |
|-------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| Leak at gland nut                                     | Gland nut is either too loose or too tight. O ring has failed due to age.                                                             | Replace black O ring. Hand tighten gland nut firmly.                                                                                                                                                                       |
|                                                       | Corroded gland nut due to persistent leak.                                                                                            | Replace gland nut.                                                                                                                                                                                                         |
| Leak at inlet/outlet port                             | Plumbing fittings are too loose. Teflon tape is missing.                                                                              | Clean threads and reseal with teflon tape. Retighten.                                                                                                                                                                      |
| Hot water coming out of faucet                        | UV system is too large for building, or installed very close to faucet.<br>First water usage after prolonged period of no water flow. | Flush hot water after long periods of non-use by flushing a toilet or running a tap. Metal plumbing will dissipate heat more effectively than plastic plumbing will.                                                       |
| Black marks on UV lamp ends                           | This is expected and normal.                                                                                                          | UV lamps have a small amount of excess mercury that will oxidize on the inside of the lamp tube almost immediately after being lit. If a brand new lamp has these markings it was lit momentarily as part of a QC process. |
| Condensation on chamber exterior                      | High humidity in installation site.                                                                                                   | Moderate condensation is normal. Protect floor below unit from dripping water, install ballast above UV chamber. Severe condensation can result in moisture forming inside the quartz sleeve which can damage the lamp.    |
| Lamp is on, but treated water fails bacterial testing | Recontamination is occurring in plumbing distribution system.                                                                         | Disinfect plumbing distribution system.<br>Check bypass valve, if present, for leaks.                                                                                                                                      |
|                                                       | Input bacterial counts are so high the UV system cannot reduce them, even when operating at normal parameters.                        | Can be confirmed by diluting test samples. Shock disinfect holding tanks, increase pretreatment, or oversize your UV system.                                                                                               |
|                                                       | Input water quality does not meet requirements, which is impeding system performance.                                                 | Improve pre-treatment to meet water quality requirements.                                                                                                                                                                  |

TROUBLESHOOTING (Standard)

| GREEN LED                                                                           | RED LED                                                                                         | AUDIO                  | POSSIBLE ISSUE                                                                                                                   | SUGGESTED ACTION                                                                                                                                                      |
|-------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------|------------------------|----------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|  | <br>FLASHING | intermittent           | System is in lamp change timer mode.                                                                                             | Silence alarm by pressing override button. Install new lamp. If new lamp has been installed, follow lamp timer reset procedure.                                       |
|  |              | intermittent           | System is in lamp expired alarm mode.                                                                                            | Install new lamp. If new lamp has been installed, follow reset lamp timer procedure.                                                                                  |
|                                                                                     |                                                                                                 | intermittent           | System is in lamp failure alarm.                                                                                                 | Unplug ballast from AC supply, wait 15 seconds, then plug back in. If this does not resolve the issue, replace first the UV lamp then, if not successful, UV ballast. |
|                                                                                     |                                                                                                 | constant/<br>squealing | Ballast has suffered severe damage - likely causes include power surges, water damage, or third party lamp catastrophic failure. | Replace ballast.                                                                                                                                                      |



# TROUBLESHOOTING (Monitored)

| CODE                            | POSSIBLE ISSUE                                                                                               | SUGGESTED ACTION                                                                                                                                                                                                                                                                                                                                       |
|---------------------------------|--------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| E1 - Low UV Alarm               | Input water does not meet water quality requirements.                                                        | Test input water to confirm it meets pretreatment requirements.<br>Improve pretreatment chain to resolve any deficiencies.                                                                                                                                                                                                                             |
|                                 | Quartz components (sleeve & sensor window) are fouled.                                                       | Quartz components should be cleaned annually and replaced every 3 years as a minimum. Fouling will require more frequent cleaning and replacement.                                                                                                                                                                                                     |
|                                 | Solenoid valve installed without a remote solenoid interface (RSI).                                          | Solenoid valves must have a remote solenoid interface (RSI) to provide independent power.                                                                                                                                                                                                                                                              |
| E3 - Sensor Communication Error | Sensor is not connected properly.<br>Sensor failure.                                                         | Unplug and replug sensor cable to ensure it is fully inserted.<br>If the alarm code continues, replace the UV sensor.                                                                                                                                                                                                                                  |
| E4 - Alarm Override Active      | Status code indicating that the alarm override is active.                                                    | The alarm override will expire after 24 hrs.<br>To turn the override off early, press the button; the E4 code should clear.                                                                                                                                                                                                                            |
| E5 - Change Lamp                | The lamp needs to be replaced in the next 28 days.                                                           | Purchase a replacement lamp. After installing, perform the lamp timer reset procedure to clear the E5 code. The audio alarm can be silenced for 7 days at a time up to 28 days by pressing the button.                                                                                                                                                 |
| E6 - Lamp Expired Alarm         | The lamp has expired.                                                                                        | The lamp must be replaced immediately. The audio alarm can no longer be silenced. The UV lamp is still lit during this alarm, and the solenoid valve will remain open.                                                                                                                                                                                 |
| E7 - Sensor Self Test Failure   | Low UV level prevents self test from completing.                                                             | If the system is also in the E1 Low UV Alarm, the sensor self test will not be able to complete. Resolving the low UV condition will also resolve the E7.                                                                                                                                                                                              |
|                                 | Sensor malfunction.                                                                                          | If there is no accompanying E1 error code, power the system down completely and then turn it back on. If E7 remains, replace the UV sensor.                                                                                                                                                                                                            |
| oh - Overheat Mode              | Status code indicating water temperature in the system has risen above 45°C (113°F).                         | No action is required. 'oh' will clear when water is run through the system.<br>If a fan is installed, it will turn on to improve UV output during high heat conditions.                                                                                                                                                                               |
| nd - No Data                    | Should display briefly upon start up.<br>If appearing during regular operation, the system is power cycling. | Power cycling can be due to:<br>Line voltage irregularities - ensure system is on dedicated line; generally poor line voltage may require a UPS line conditioner.<br>Solenoid valve installed without an RSI - see note in E1 section.<br>UV lamp malfunction - replace the UV lamp.<br>UV ballast malfunction - replace the UV ballast (least likely) |

## WARRANTY

UVDynamics water disinfection systems are supported with a 'free from defects' **Workmanship and Material** warranty as follows:

- A ten year pro-rated warranty on the stainless steel disinfection chamber
- A three year warranty on the UV power source
- A one year warranty on UV lamps, sleeves, sensor and solenoid

Warranty commences from date of purchase. Proof of purchase required

UVDynamics will repair or replace, at its option, any defective parts covered by the warranty. Shipping and handling are not included in this warranty. Parts for warranty evaluation will be collected from you by your Dealer. Replacement parts provided under warranty will be sent to your UVDynamics dealer. Parts repaired or replaced under the pro-rated warranty will be covered under warranty to the end of the original warranty period. This warranty is also subject to the conditions and limitations outlined under the heading "General Conditions and Limitations" below.

### Warranty for Replacement Lamps and Parts

UVDynamics warrants replacement lamps, purchased for annual routine maintenance and other parts purchased to repair product components that are no longer covered by the original warranty, to be free from defects in material and workmanship for a period of one (1) year from the date of purchase. During this time, UV Dynamics will repair, or replace at its option, a defective replacement lamp or part free of charge except for shipping and handling charges. The warranty period on replacement lamps and parts will be verified using date codes and/or purchase receipts. Your UVDynamics Dealer will advise you on whether the defective item needs to be returned to UVDynamics for analysis.

### General Conditions and Limitations

None of the above warranties cover damage caused by improper use or maintenance, accidents, acts of God or minor scratches or imperfections that do not materially impair the operation of the product. The warranties also do not cover products that are not installed as outlined in the applicable Owner's manual. These limited warranties outline the exclusive remedy for all claims based on a failure or defect in any of these products. They are in lieu of all other warranties whether written, oral or implied or statutory. Under no circumstance shall UVDynamics have any liability for liquidated damages for collateral, consequential or special damages or for loss of profits, or for actual losses or for loss of production or progress of construction, regardless of the cause of such damages or losses. In any event, UVDynamics aggregate total liability shall not exceed the specific product purchase price. The purchaser agrees to indemnify and hold harmless UVDynamics from all claims by third parties in excess of these limitations. UVDynamics does not assume any liability for personal injury or property damage caused by the use or misuse of any of its products. UVDynamics shall not in any event be liable for special, incidental, indirect or consequential damages. UVDynamics liability shall, in all instances, be limited to replacement of the defective product or part and this liability will terminate upon expiration of the applicable warranty period.

PRODUCT SPECIFICATIONS

|                                   | UVD600                                                       |          | UVD800                               |          | UVD1000                              |           | UVD1200                              |           | UVD1500                              |           |
|-----------------------------------|--------------------------------------------------------------|----------|--------------------------------------|----------|--------------------------------------|-----------|--------------------------------------|-----------|--------------------------------------|-----------|
|                                   | UVD600                                                       | UVD600/S | UVD800                               | UVD800/S | UVD1000                              | UVD1000/S | UVD1200                              | UVD1200/S | UVD1500                              | UVD1500/S |
| Rated Flow Rate <sup>♦</sup>      | 15gpm @ 40mJ/cm²<br>20gpm @ 30mJ/cm²                         |          | 20gpm @ 40mJ/cm²<br>26gpm @ 30mJ/cm² |          | 25gpm @ 40mJ/cm²<br>33gpm @ 30mJ/cm² |           | 30gpm @ 40mJ/cm²<br>40gpm @ 30mJ/cm² |           | 37gpm @ 40mJ/cm²<br>50gpm @ 30mJ/cm² |           |
| Isolated Solenoid Drive           | yes                                                          |          |                                      |          |                                      |           |                                      |           |                                      |           |
| UV Detect Monitoring <sup>†</sup> | no                                                           | yes      | no                                   | yes      | no                                   | yes       | no                                   | yes       | no                                   | yes       |
| AC Supply Voltage                 | 120V 47-63 Hz .7A (240V 47-63Hz .35A)                        |          |                                      |          |                                      |           |                                      |           |                                      |           |
| Power Consumption                 | 67 watts                                                     |          | 96 watts                             |          | 96 watts                             |           | 117 watts                            |           | 117 watts                            |           |
| Chamber Material                  | passivated 304 SS manufactured from A249 pressure rated tube |          |                                      |          |                                      |           |                                      |           |                                      |           |
| Max. Operating Pressure           | 100 psi                                                      |          |                                      |          |                                      |           |                                      |           |                                      |           |
| Max. Ambient Temp.                | 50C (122F)                                                   |          |                                      |          |                                      |           |                                      |           |                                      |           |
| Water Temp. Range                 | 4 - 37C (40 - 99F)                                           |          |                                      |          |                                      |           |                                      |           |                                      |           |
| Lamp Service Life                 | 9000 hours (approx. 1 year)                                  |          |                                      |          |                                      |           |                                      |           |                                      |           |
| Lamp Change Timer                 | yes (audio and visual)                                       |          |                                      |          |                                      |           |                                      |           |                                      |           |
| Chamber Dimensions                | 37" x 3.5"                                                   |          | 37" x 3.5"                           |          | 37" x 4"                             |           | 50.5" x 3.5"                         |           | 50.5" x 4"                           |           |
| Inlet/Outlet Port Size            | 1" MNPT                                                      |          |                                      |          |                                      |           |                                      |           |                                      | 1¼" MNPT  |

♦ flow rates assume 95% UVT † monitored systems are calibrated at 40mJ/cm²

REPLACEMENT PARTS

|                    |      |                                                        |        |        |        |        |        |        |        |        |        |
|--------------------|------|--------------------------------------------------------|--------|--------|--------|--------|--------|--------|--------|--------|--------|
| UV Lamp            |      | 400158                                                 |        | 400158 |        | 400158 |        | 400271 |        | 400271 |        |
| Quartz Sleeve      |      | 400157                                                 |        | 400157 |        | 400157 |        | 400275 |        | 400275 |        |
| Electronic Ballast | 120V | 400156                                                 | 400356 | 400233 | 400357 | 400233 | 400357 | 400233 | 400357 | 400233 | 400357 |
|                    | 240V | 400122                                                 | 400632 | 400414 | 400633 | 400414 | 400633 | 400414 | 400633 | 400414 | 400633 |
| O Ring Kit         |      | 400205                                                 |        |        |        |        |        |        |        |        |        |
| Gland Nut          |      | TOP GLAND NUT: 400103   GLAND NUT W/ HOLE PLUG: 400287 |        |        |        |        |        |        |        |        |        |
| Lamp Spring        |      | 400111                                                 |        |        |        |        |        | 400354 |        |        |        |
| UV Sensor Probe    |      | 400195                                                 |        |        |        |        |        |        |        |        |        |



315 Neptune Crescent, London, ON, Canada  
800.667.4629 519.452.7520  
support@uvdynamics.com  
www.uvdynamics.com